

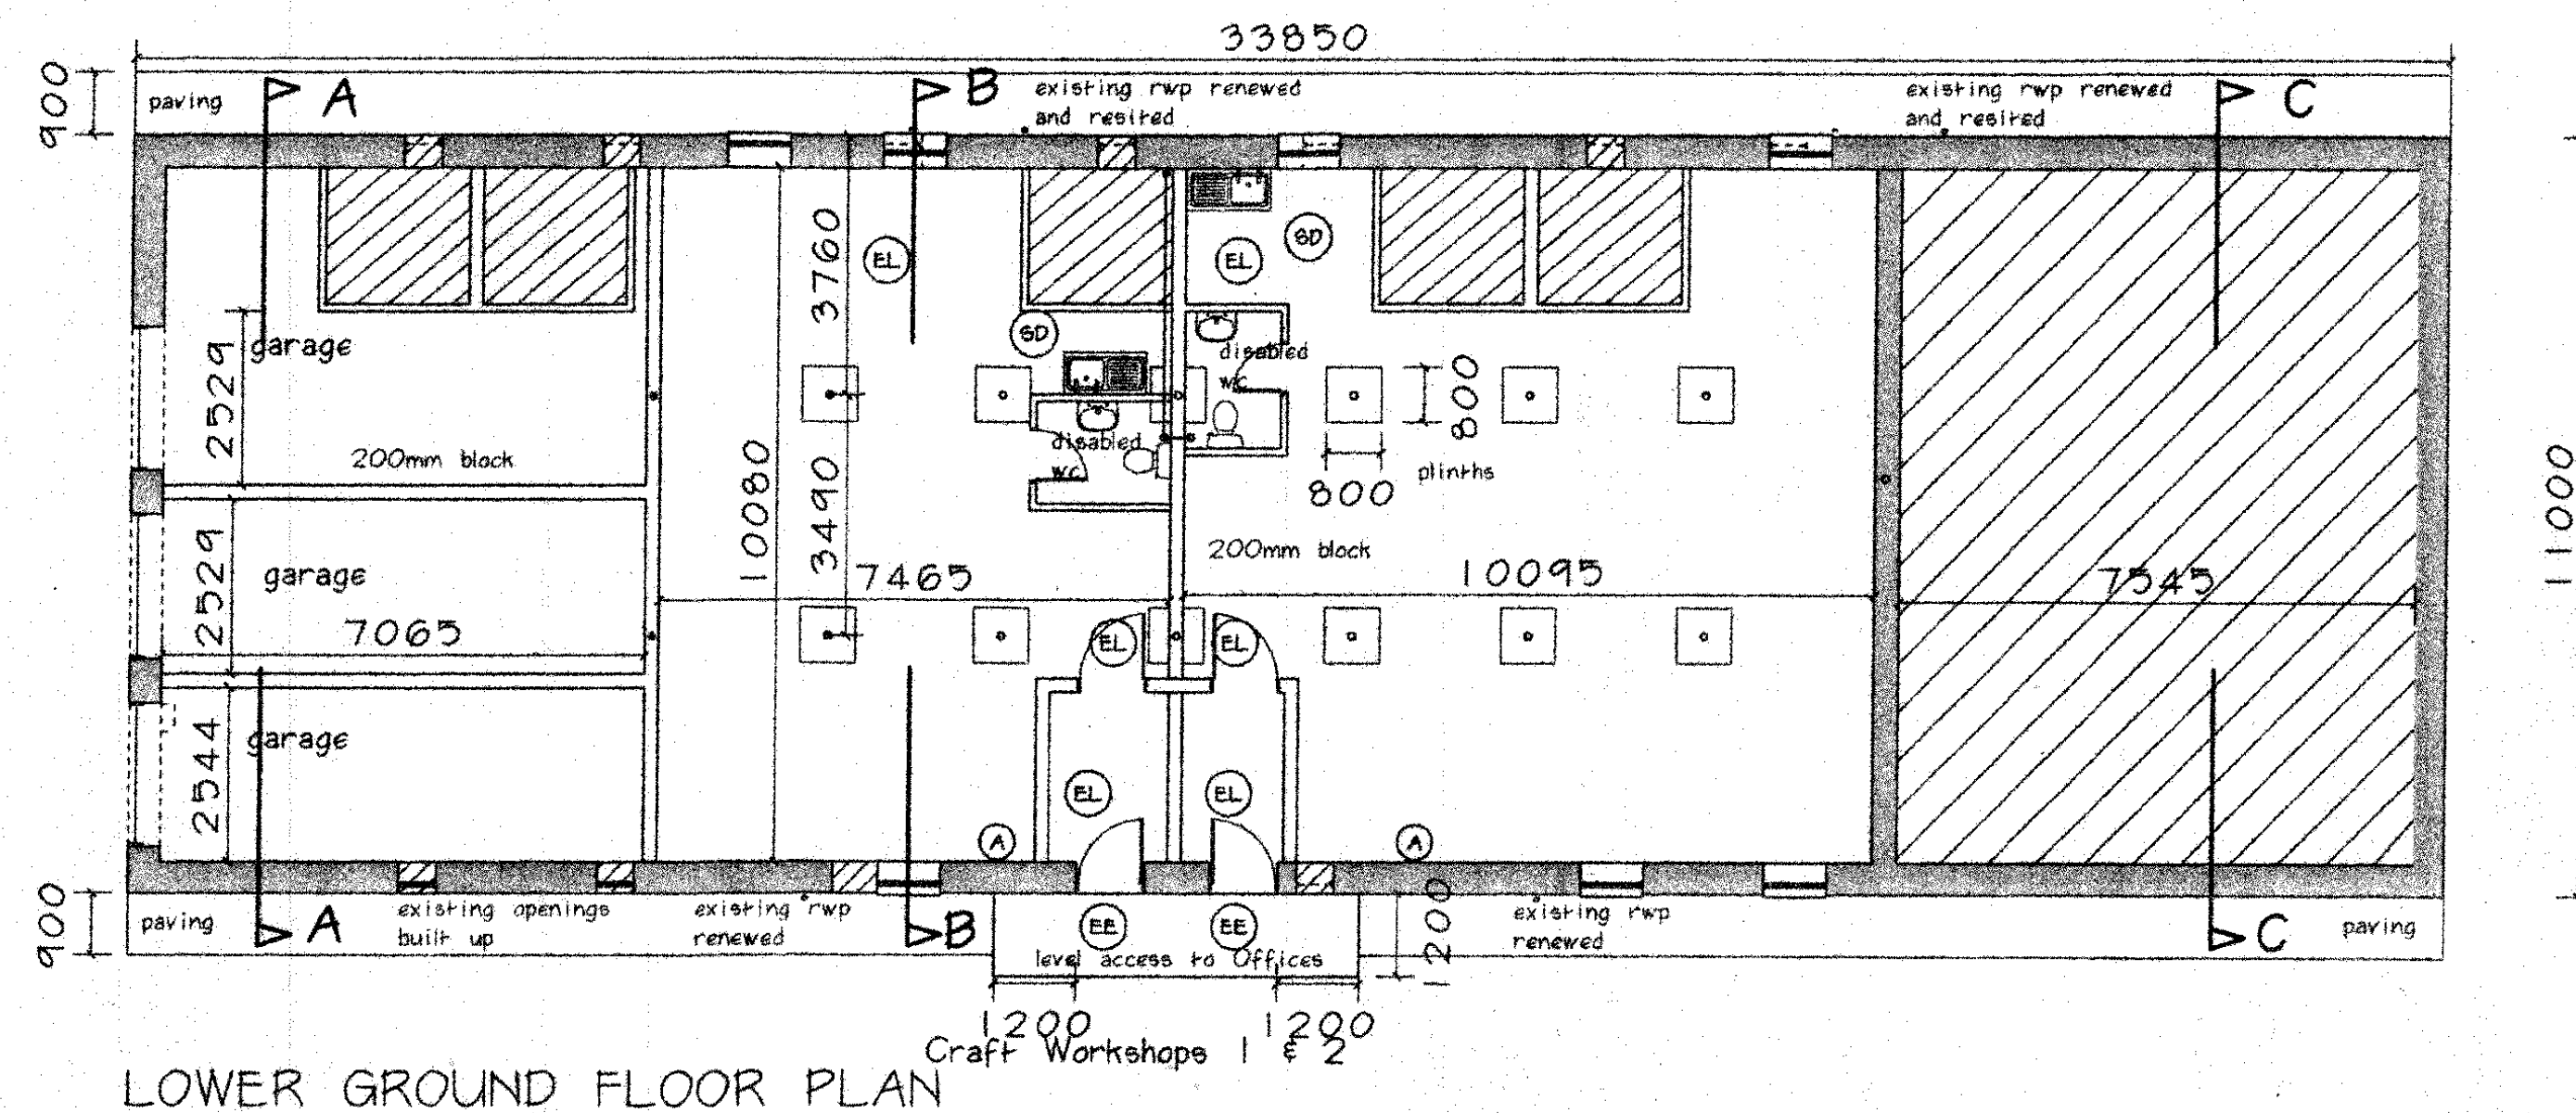
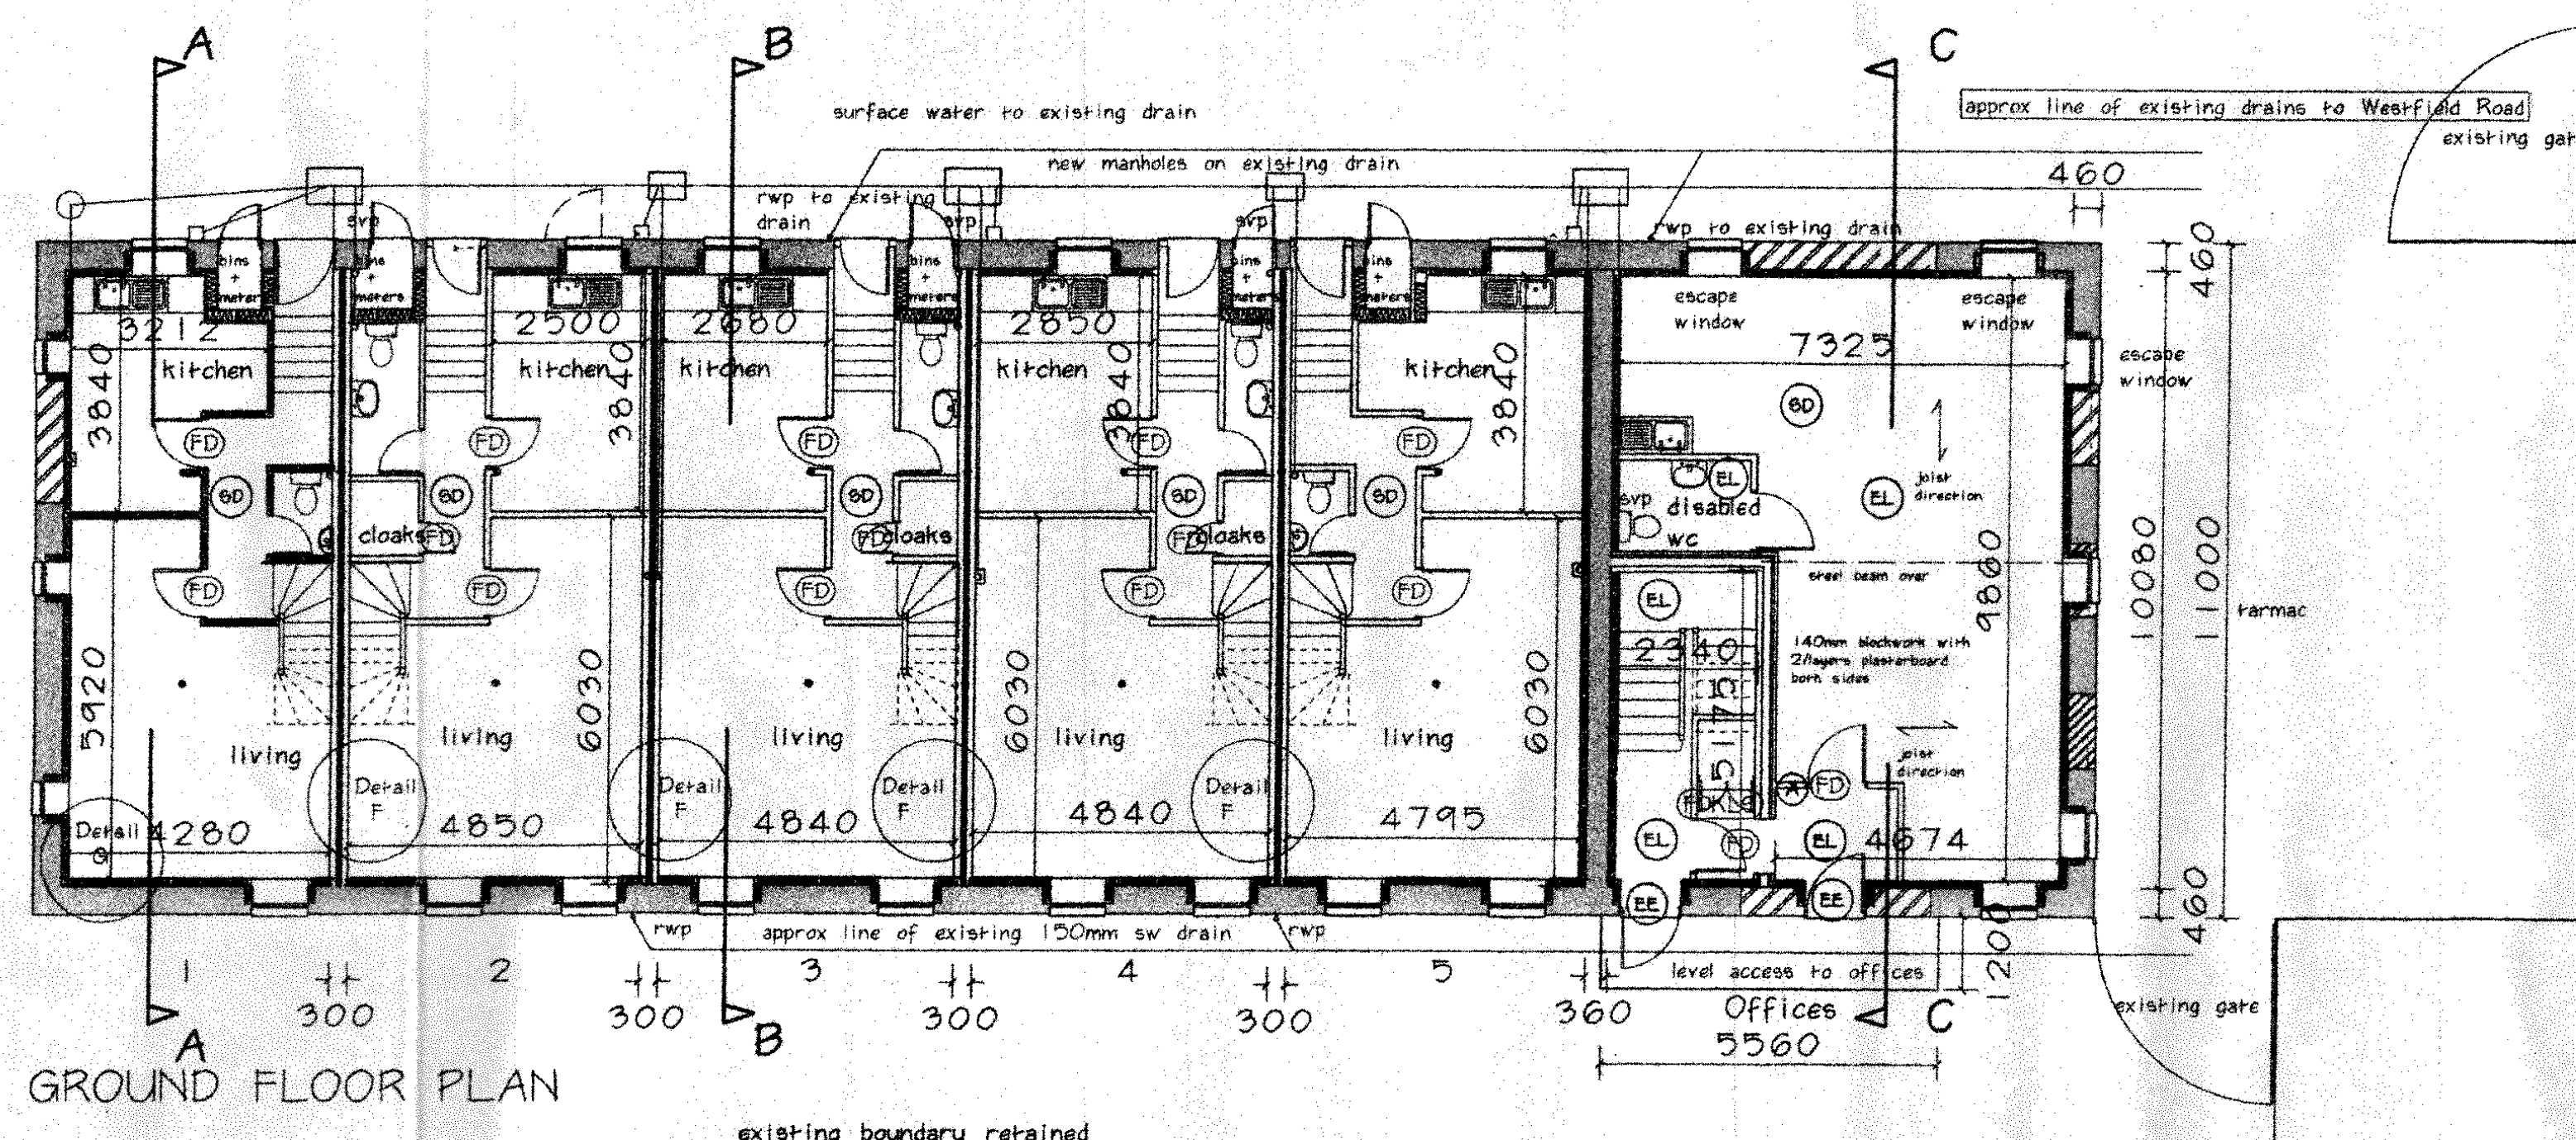


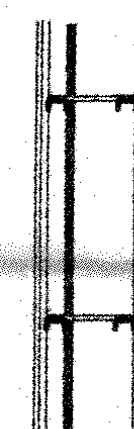

← North

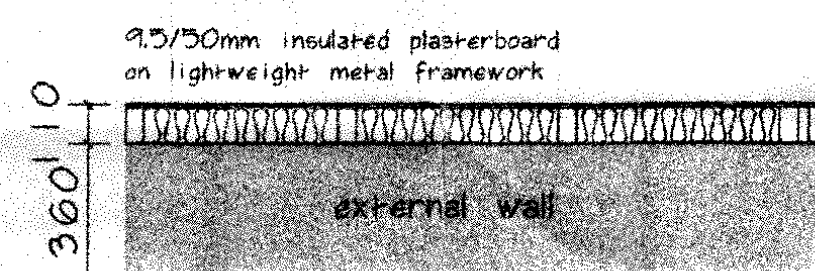

Emergency Lighting/Fire Alarm/ Smoke Detection Schedule
to Offices and Workshops

- (SD) - Smoke Detector Linked to Fire Alarm and Emergency Lighting Installations
- (A) - Fire Alarm Actuation Point
- (EL) - Emergency Light
- (EE) - Emergency Exit
- (FDKLG) - Fire Door Keep Locked Shut

Fire Alarm and Smoke Detection System installed by Specialist to BS 5839

HOUSES

Mains Interlinked Smoke Alarm in halls/landings

WORKSHOPS

Level access to principal entrances
ALL provisions in respect of Part "M" will be satisfied

OFFICES

Level access to principal entrances
ALL provisions in respect of Part "M" will be satisfied

VENTILATION SYSTEMS

BACKGROUND VENTILATION AND INTERMITTENT EXTRACT FANS

DWELLINGS - PART "F"


As Table 1.1a - Extract ventilation rates, Kitchens 60 l/s, Bathrooms 15 l/s

As Table 1.1b - Whole building ventilation rates, 25l/s

OFFICES

As Table 2.1a - Extract ventilation rates, Sanitary 6 l/s per WC,

Beverage Preparation 15 l/s
As Table 2.1.b - Whole building ventilation rates, 10 l/s per person

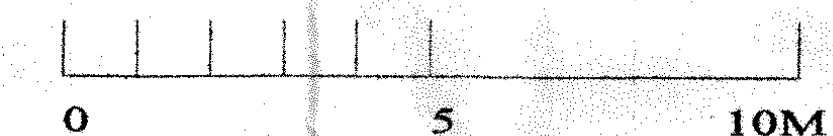

L	Scale Bar Added Resubmission	Feb10
K	Building Regulations Amendments 11 Nov 06	Nov 06
J	Building Regulations Amendments 23 Aug 06	Ocr 06
I	Building Regulations Amendments 06/07/06	Jul 06
H	Building Regulations	Jun 06
G	Building Regulations	Mar 06
F	Planners letters received 11 Feb 2006	Feb 06
E	5 Dwellings/Offices/Workshops/Affordable	Nov 05
D	5 Dwells/Offices/Workshops/retails	Aug 05
C	5 Dwellings/Offices/Workshops	Jun 05
B	Conservation Comments 22/03/05	Mar05
A	1gf wall thickness	
	Revisions	

John Groves

Architecture + Surveying

Computer Aided Drawing • Refurbishing • Services

The Drawing Room
13 Templar Gardens
Wetherby LS22 7TA
Tel/Fax 01937 581318

Client:

DALTON JOINERY LTD
THE OLD MALT KILN
TOCKWITH

Project:

CHANGE OF USE
WORKSHOP TO DWELLINGS
OFFICES AND WORKSHOPS

Drawing:

PROPOSED
PLANS AND
DETAILS F & G

Scale

1/100, 1/20

Date

OCT 04

Drawn

JG

Drawing no

02/22/04

Revision

L